

SCENARIO 1
Dagslysberegning for mulig tilbygning
2 etagers kontorbygning
Tonsbakken, Skovlunde

DAGSLYSFAKTOR
1,7180 / 17,18%
Overholder BR18


DAGSLYSFAKTOR
1,0022 / 10,02%
Overholder BR18

DAGSLYSFAKTOR
1,3099 / 13,10%
Overholder BR18


Stueplan
1:100




Syd
1:100

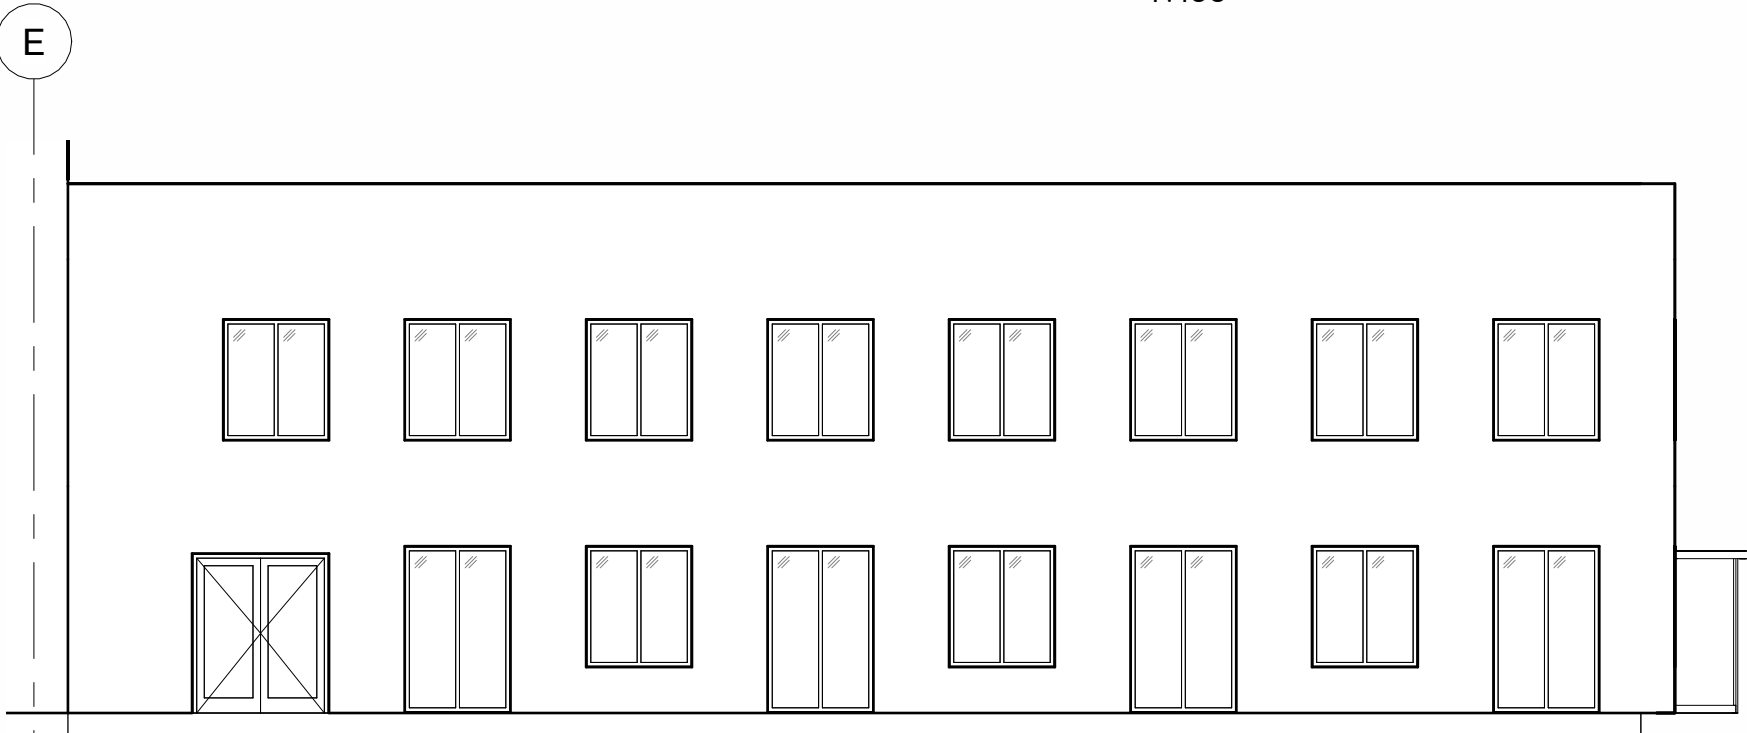

Vest
1:100

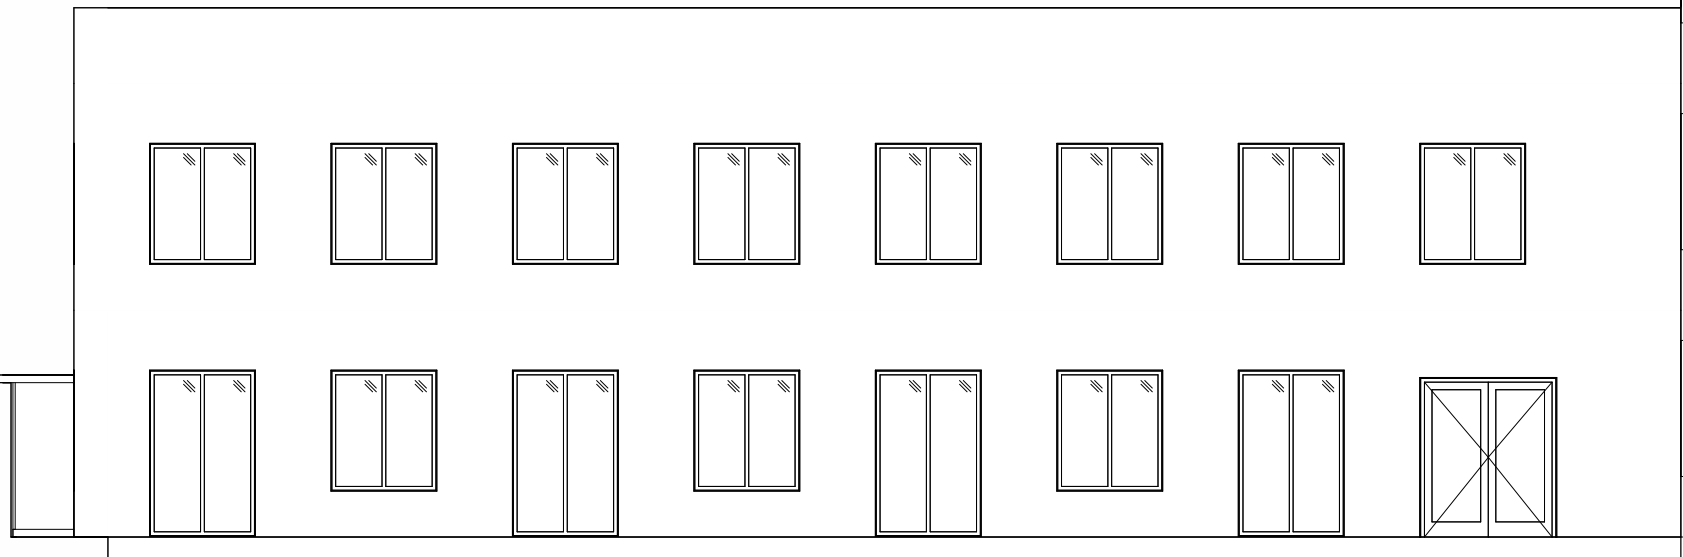

Øst
1:100

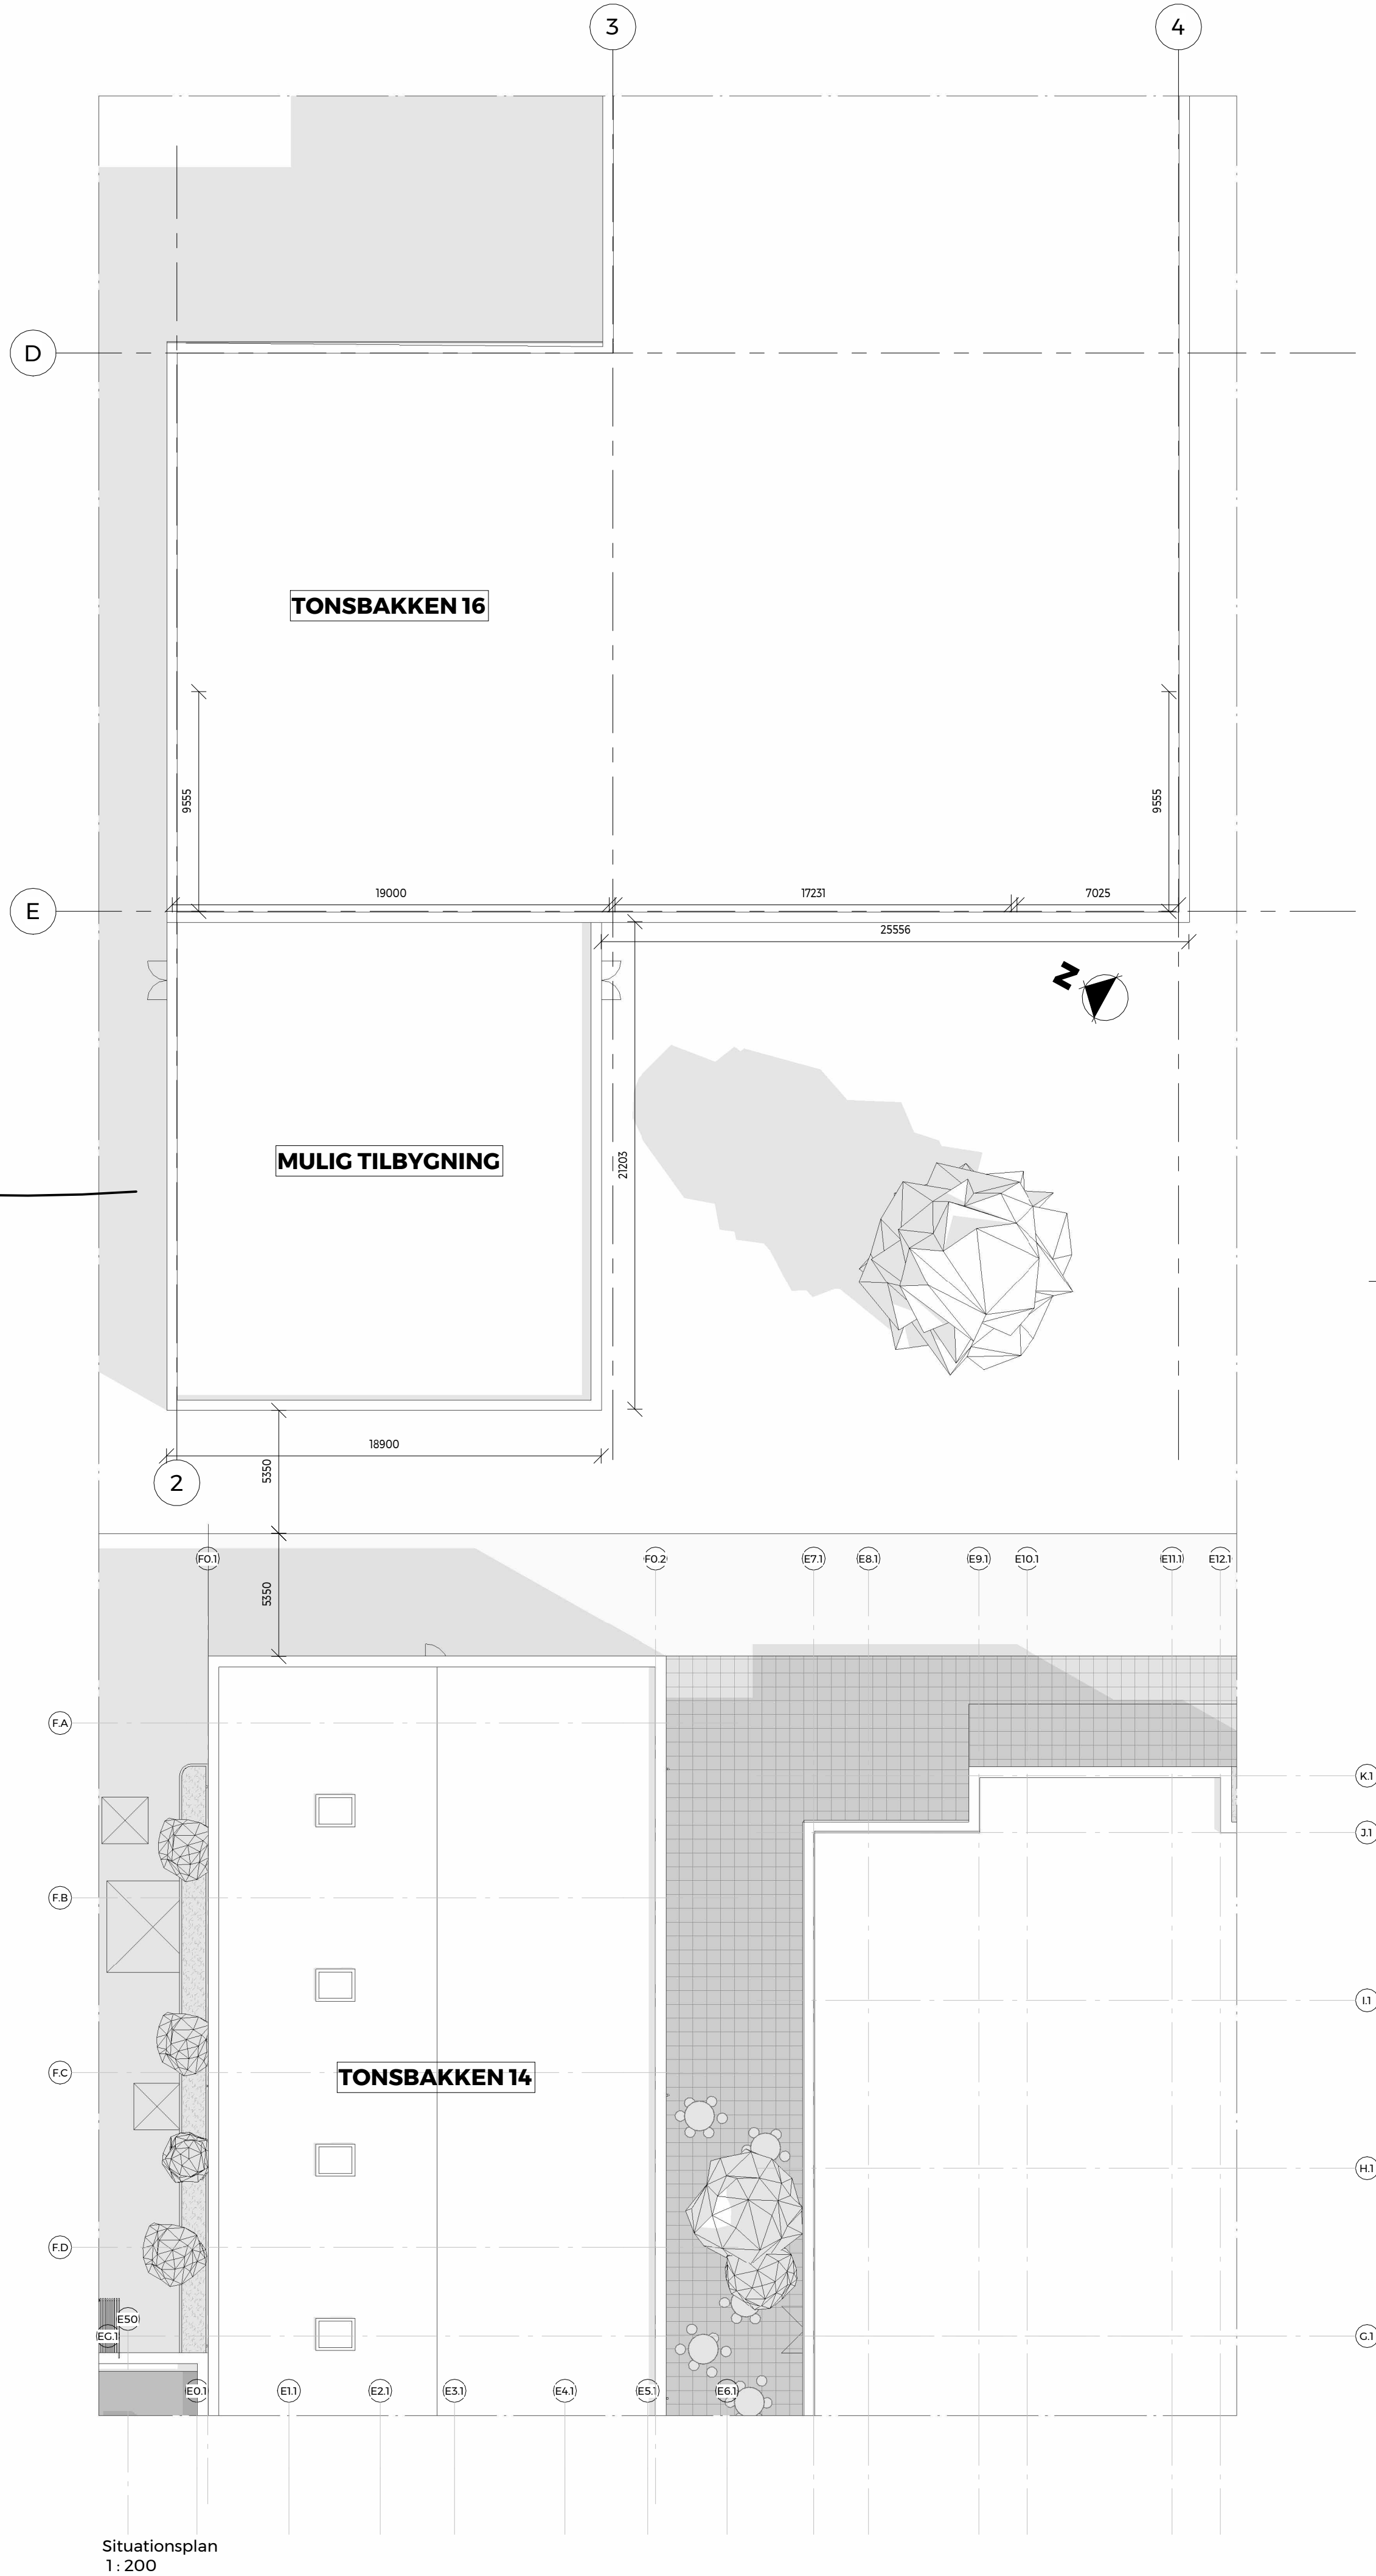

Situationsplan
1:200